



LUMINAIRE AS PER SPEC. & BOQ. THE LUMINAIRE SHALL BE APPROVED BY THE ENGINEER BEFORE ORDERING/ INSTALLATION

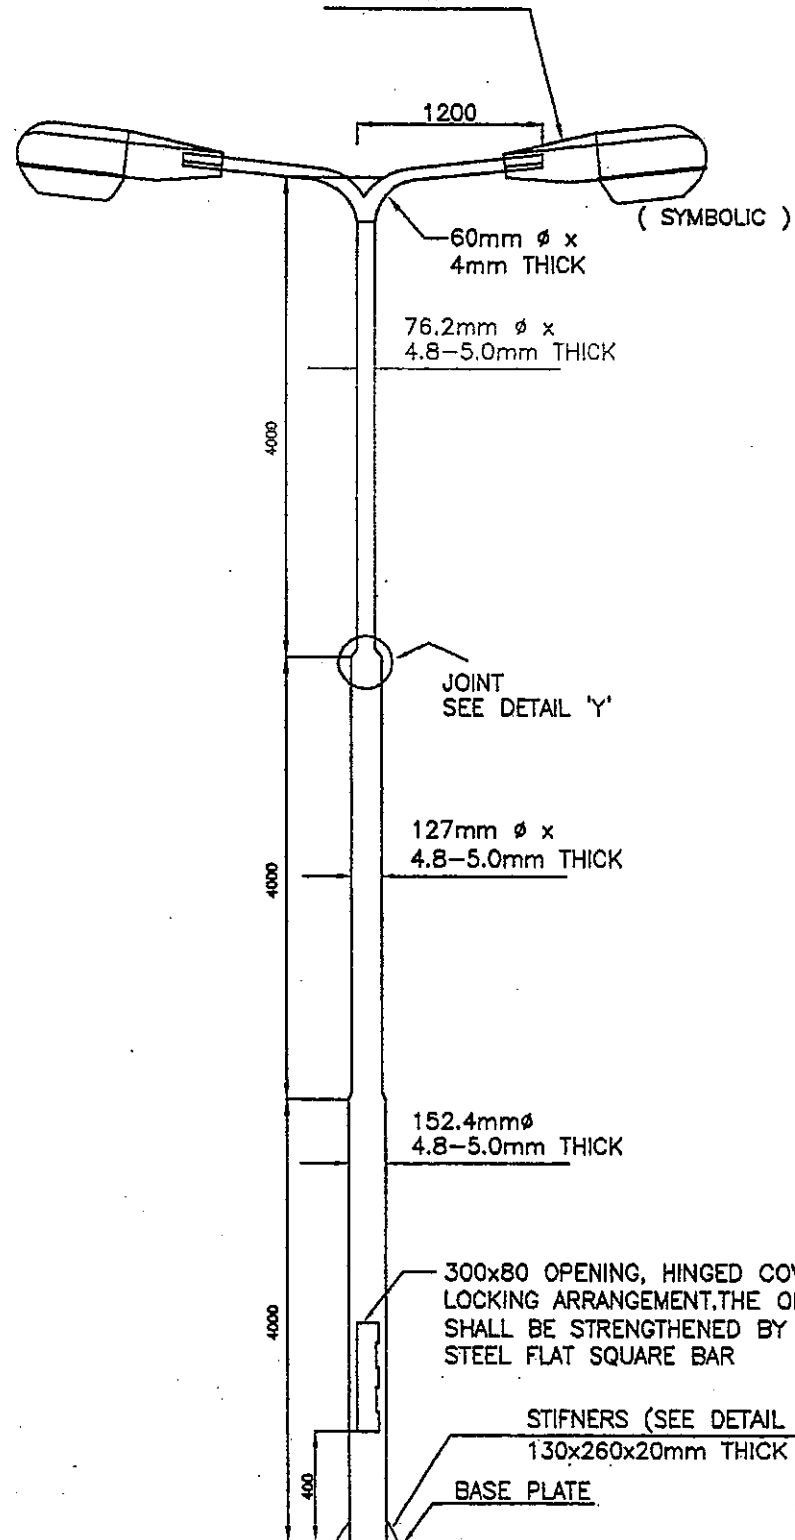

DOUBLE LUMINAIRE HOT  
DIP GALVANIZED STEEL  
TUBULAR POLE (12 m HIGH)

LUMINAIRE AS PER SPEC. & BOQ. THE LUMINAIRE SHALL BE APPROVED BY THE ENGINEER BEFORE ORDERING/ INSTALLATION

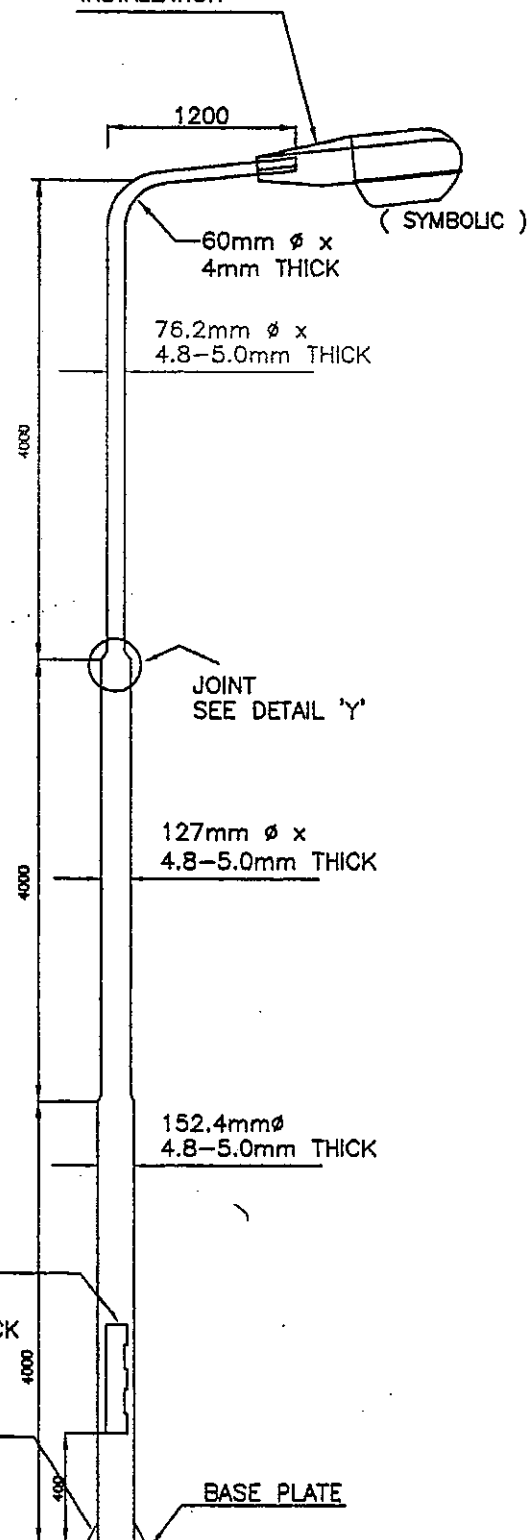

SINGLE LUMINAIRE HOT  
DIP GALVANIZED STEEL  
TUBULAR POLE (12 m HIGH)

